



We help ideas meet the real world

DELTA Test Report



 **DANAK**
TEST Reg. no. 100

Measurement of sound absorption coefficient for Fraster felt SpaceCover

Performed for Fraster ApS

DANAK 100/1873-E

Project no.: I100645

Page 1 of 9

27 November 2014

DELTA
Venlighedsvej 4
2970 Hørsholm
Denmark

Tel. +45 72 19 40 00
Fax +45 72 19 40 01
www.delta.dk
VAT No. 12275110

Title

Measurement of sound absorption coefficient for Fraster felt SpaceCover

Journal no.	Project no.	Our ref.	Date of test
DANAK 100/1873-E	I100645	DH/HSO/ilk	17 November 2014

Client

Fraster ApS
Linåvej 9a-b
8600 Silkeborg
Denmark

Client ref.

Trine Neve

Summary

Laboratory measurements of the sound absorption coefficient were carried out in a reverberation room according to the test method of EN ISO 354:2003.

Product: Fraster felt SpaceCover.
Perforation 10 %.
Thickness: 2 x 3 mm
Mounting depth: Free-hanging

The felt was mounted as a free-hanging plane in the reverberation room.

The test results per one-third octave and per octave are shown in tabular form and graphically on the graph sheets together with the weighted sound absorption coefficient α_w and the absorption class according to EN ISO 11654:1997.

Descriptions of reverberation room and test procedure are found in Appendix 1.

Remark

The test results apply only to the objects tested.

DELTA, 27 November 2014



Dan Hoffmeyer
Acoustics



1. Introduction

At the request of Fraster ApS measurements of the sound absorption coefficient in a reverberation room were carried out for a felt absorber.

2. Description of the test specimen based on the client's specifications

Product: Fraster felt SpaceCover.
Perforation 10 %.
Thickness: 2 x 3 mm

3. Mounting in the laboratory

The felt was mounted as a free-hanging plane with the size 3.00 m × 3.70 m in a wooden beam suspended from the concrete ceiling of the reverberation room. The test specimen consisted of several pieces sewn or butted together. At the top and bottom of the test specimen aluminium profiles were mounted in rod pockets.

The test specimen was placed so that no part of it was closer than 1 m to the walls. The distance to the ceiling and floor was 0.55 m and 0.7 m, respectively.

A photo of the mounting in the laboratory is shown in Figure 1 on page 6.

4. Test method

The measurements were carried out according to the test method of EN ISO 354:2003: "Measurement of Sound Absorption in a Reverberation Room".

The sound absorption coefficient was calculated from the reverberation times measured with and without the test specimen. As the free-hanging felt is exposed on both sides, the absorption coefficient is the equivalent absorption area of the test specimen divided by the area of the two sides of the test specimen.

The measurements were performed in Room 005, Building 355 at the Technical University of Denmark. Brief descriptions of the reverberation room and test procedure are found in Appendix 1.



5. Instrumentation

The following instruments were used for the test:

Instrument	Type	A&V No.
Sonud Level Meter / Analyser	B&K 2270	1498L
Measuring Microphone	B&K 4144	1256L
Measuring Microphone	B&K 4144	859L
Microphone Preamplifier	B&K 2619	1188L
Microphone Preamplifier	B&K 2619	857L
Microphone Power Supply	B&K 2807	722L
Sensor for Temperature and Humidity	Elpro Ecolog TH1	1216L

6. Measurement conditions

The reverberation time was recorded in 6 microphone positions, each placed in the range 1.55 m to 2.85 m above the floor. The number of sound source positions was two.

The reverberation time T_1 per third octave of the room without test specimen and the reverberation time T_2 per third octave of the room with test specimen:

Frequency f [Hz]	Reverberation Time T_1 [sec.]	Reverberation Time T_2 [sec.]
100	7.80	6.37
125	9.31	6.20
160	9.11	5.05
200	9.04	4.61
250	7.33	3.75
315	7.39	3.44
400	7.11	3.03
500	6.55	2.51
630	6.54	2.40
800	5.94	2.16
1000	5.37	1.98
1250	5.15	1.88
1600	4.83	1.67
2000	4.28	1.56
2500	3.87	1.46
3150	3.07	1.29
4000	2.63	1.17
5000	2.20	1.05



Temperature and relative humidity in the reverberation room during measurements:

Room without test specimen: 18.3°C, 61% RH. Date of test: 17 November 2014

Room with test specimen: 18.4°C, 62% RH. Date of test: 17 November 2014

The correction of the absorption coefficient due to differences in temperature and relative humidity during measurements of T_1 (the reverberation time of the empty room) and T_2 (the reverberation time of the room with test specimen) was 0.01 at 5000 Hz and 0 at all other frequencies.

7. Test results

The test result α_s per one-third octave from 100 Hz to 5000 Hz is shown in tabular form and graphically on Graph Sheet 1.

The calculated, practical sound absorption coefficient α_p per octave from 125 Hz to 4000 Hz is shown on Graph Sheet 2 together with the weighted sound absorption coefficient α_w as well as the absorption class. These values are calculated in accordance with EN ISO 11654:1997.

8. Measurement uncertainty

Measurement uncertainty (90 % confidence interval) estimated from a Nordic intercomparison (Nordtest Project No. 1023-92) for the practical absorption coefficient α_p per octave:

Frequency [Hz]	Uncertainty
125	±0.15
250	±0.10
500	±0.05
1000	±0.10
2000	±0.10
4000	±0.10



Figure 1
Photo of the mounting of the test specimen in the laboratory.



Laboratory measurement of sound absorption coefficient according to EN ISO 354:2003

Client: Fraster ApS, Linåvej 9a-b, 8600 Silkeborg, Denmark

Date of test: 17 November 2014

Test specimen: Fraster felt SpaceCover.
Perforation 10 %.
Thickness: 2 x 3 mm


Mounting depth: Free-hanging in the room

Test area: 11.1 m² (one side)*

Room volume: 215 m³

Room surface: 305 m²

Frequency f [Hz]	α_s
100	0.05
125	0.08
160	0.14
200	0.17
250	0.20
315	0.24
400	0.30
500	0.39
630	0.41
800	0.46
1000	0.50
1250	0.53
1600	0.61
2000	0.64
2500	0.67
3150	0.71
4000	0.75
5000	0.79

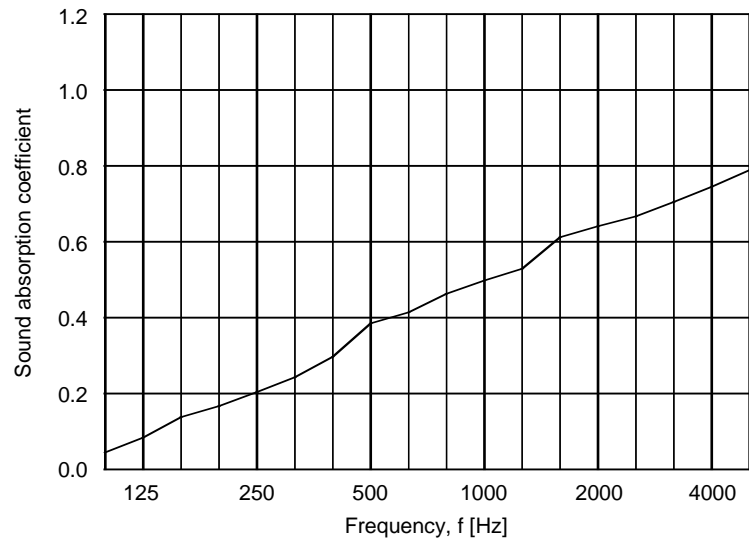

* The absorption coefficient is calculated for the area of the two sides of the test specimen.

DELTA, 27 November 2014

Dan Hoffmeyer, Acoustics





Laboratory measurement of sound absorption coefficient according to EN ISO 354:2003


Client: Fraster ApS, Linåvej 9a-b, 8600 Silkeborg, Denmark
Date of test: 17 November 2014

Test specimen: Fraster felt SpaceCover.
Perforation 10 %.
Thickness: 2 x 3 mm

Mounting depth: Free-hanging in the room

Test area: 11.1 m² (one side)*
Room volume: 215 m³
Room surface: 305 m²

Frequency f [Hz]	α_p
125	0.10
250	0.20
500	0.35
1000	0.50
2000	0.65
4000	0.75

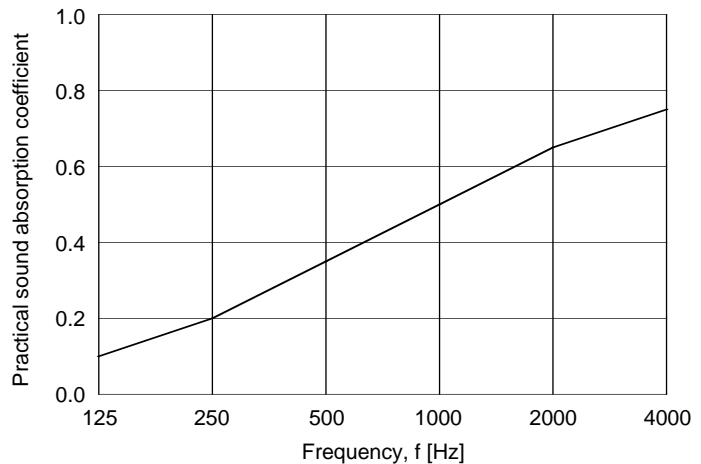

* The absorption coefficient is calculated for the area of the two sides of the test specimen.

Practical sound absorption coefficient, weighted sound absorption coefficient, and absorption class according to EN ISO 11654:1997:

$\alpha_w = 0.40(H)$ Absorption class: D

DELTA, 27 November 2014

Dan Hoffmeyer, Acoustics



Description of reverberation room

The measurements are performed in a reverberation room (Room 005, Building 355 at the Technical University of Denmark) with walls, ceiling, and floor of 300 mm in situ cast concrete. Length, width, and height of the room are 7.85 m, 6.25 m, and 4.95 m, respectively. The volume of the room is approx. 215 m³, and the total surface area is approx. 305 m². Sound diffusion elements of concrete, of damped steel plate, and of acrylic sheets are placed in the room.

Test procedure

Measurement of sound absorption according to EN ISO 354:2003 is carried out in a reverberation room. The reverberation time is measured with and without the test specimen, and the sound absorption coefficient is evaluated using Sabine's formula.

The test signal used is broad band pink noise emitted successively by two loudspeakers located in two opposite corners of the room. The reverberation time is measured in six microphone positions for each loudspeaker. For each microphone/loudspeaker position three repeated excitations are used. One-third octave filters (100-5000 Hz) are included in the receiving equipment.

The reverberation time is evaluated from the averaged slope of the decay curve over a range from 5 dB to 25 dB below the steady state level.

The sound absorption coefficient α_s is calculated using the following formula:

$$\alpha_s = \frac{55.3 \cdot V}{c \cdot S} \cdot \left(\frac{1}{T_2} - \frac{1}{T_1} \right) - \frac{4V}{S} \cdot (m_2 - m_1)$$

where V = Volume of the empty reverberation room [m³]

c = Velocity of sound in air [m/s]

S = Area of the test specimen [m²]

T_1 = Reverberation time of the empty reverberation room [s]

T_2 = Reverberation time of the reverberation room after the test specimen has been introduced [s]

m_1 = Attenuation coefficients due to air absorption during measurement of T_1 (m⁻¹)

m_2 = Attenuation coefficients due to air absorption during measurement of T_2 (m⁻¹)

The attenuation coefficient of sound in air varies with relative humidity, temperature, and frequency. During a series of measurements of reverberation times T_1 and T_2 , the relative humidity and the temperature are held as constant as possible. A correction term as given in the formula above is applied. The correction is based on data from ISO 9613-1:1993.

